

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client :	Remedial Membranes	Test Number	:	20-001915
	49 Beacon Avenue	Issue Date	:	24/04/2020
	Beacon Hill NSW 2100	Print Date	:	24/04/2020

Sample Description	Clients Ref	: "Group A"	
	Membrane applied to tiles		
	Colour :	Clear on white tiles	


AS	4586-201	3
Ap	pendix A	

Slip Resistance Classification of new Pedestrian Surface Materials Wet Pendulum Test Method

Date of Testing 23/04/202						1
Test Temperature (20±5degC)					22	°C
Sample Preparation Washed with pH neutral detergent and dried						
Test Direction Length						
Fixed/Unfixed					Unfixed	
Slider No 96 Batch No					87	
Length	1	2	3	4	5	SRV
British Pendulum	55	56	56	57	57	56
Number Classification					P5	

Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 08/11/2019 Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

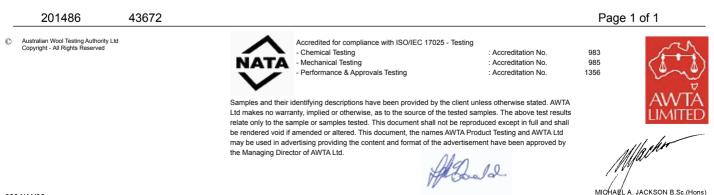

MANAGING DIRECTOR